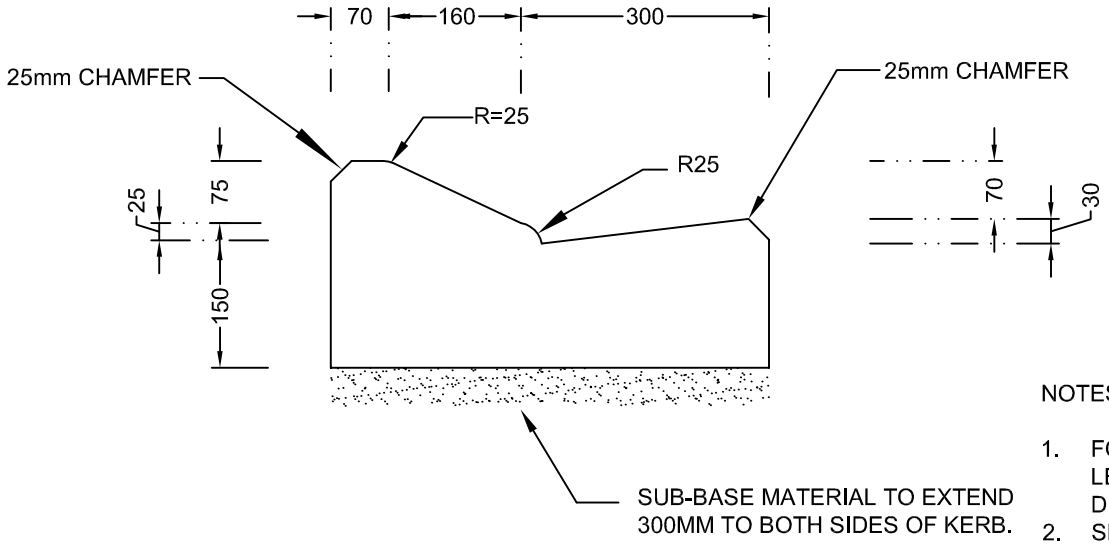


## MOUNTABLE KERB AND GUTTER

NOTES

1. FOR DIMENSIONS AND LEVELS REFER TO DESIGN DRAWINGS.
2. SL62 REINFORCEMENT TO KERB AND GUTTERS WITHIN INDUSTRIAL AREAS. REINFORCEMENT TO HAVE A MINIMUM 40mm COVER.
3. ALL WORKMANSHIP AND MATERIALS TO BE IN ACCORDANCE WITH AS 3600.
4. CONCRETE GRADE TO BE 25MPa FOR KERBS AND CHANNELS, 32MPa FOR SPOON DRAINS.
5. JOINT SPACING TO BE AT 3M CENTRES.

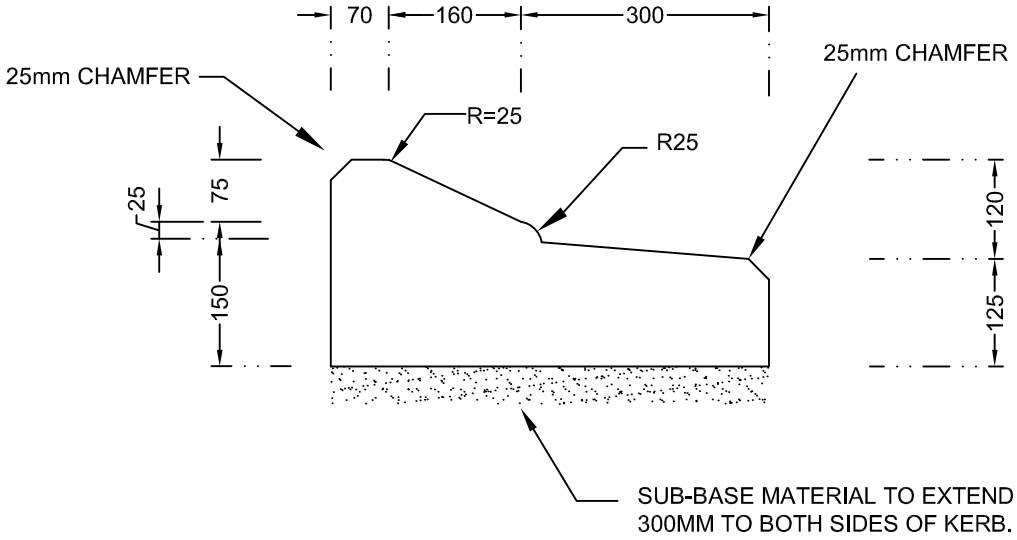


## MOUNTABLE KERB AND REVERSE GUTTER

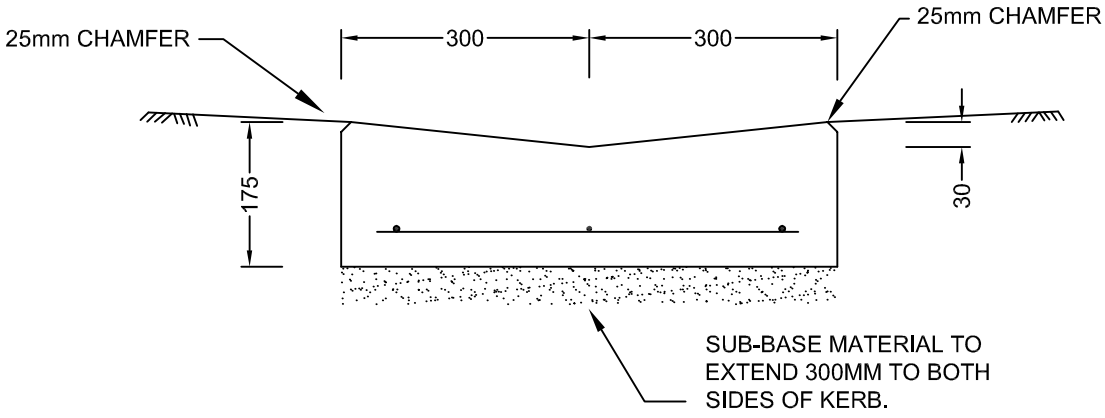


## SPOON DRAIN

| | | | |
|---|---|---|---|
| DRAWN | N. LANGLEY<br>S. HYDE | TOWN OF GAWLER | SCALE N.T.S. |
| CHECKED | D. COLLINS | STANDARD DETAILS | DRAWING NUMBER |
| DATE | JUNE 2011 | MOUNTABLE KERB AND SPOON DRAIN | SK - 304<br>REV A |