



BARRIER KERB AND GUTTER

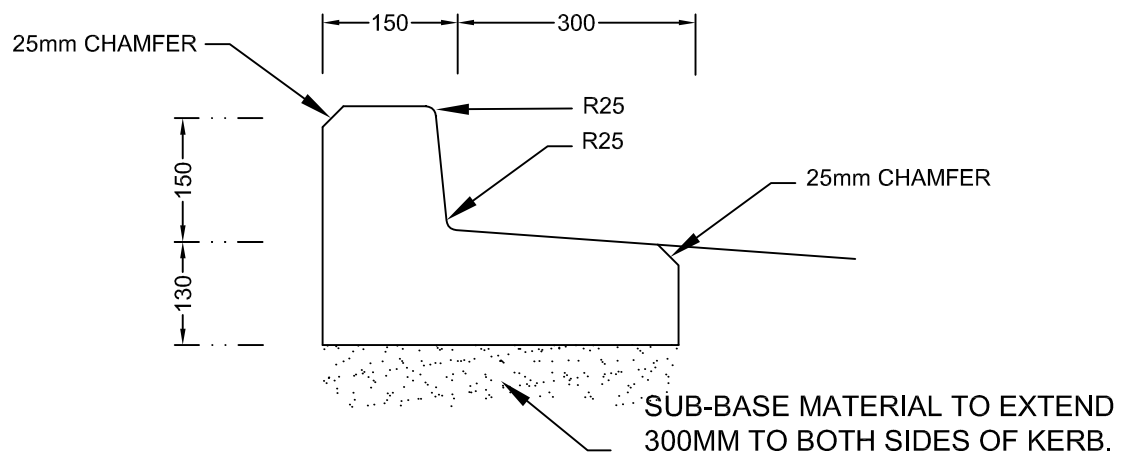

BARRIER KERB AND REVERSE GUTTER

NOTES

1. ALL WORKMANSHIP AND MATERIALS TO BE IN ACCORDANCE WITH AS 3600.
2. CONCRETE GRADE TO BE 25MPa
3. JOINTS TO BE SPACED AT EVERY 3M
4. SL62 REINFORCEMENT TO BE PLACED CENTRALLY FOR KERBS IN INDUSTRIAL AREAS. MINIMUM COVER TO BE 40mm.

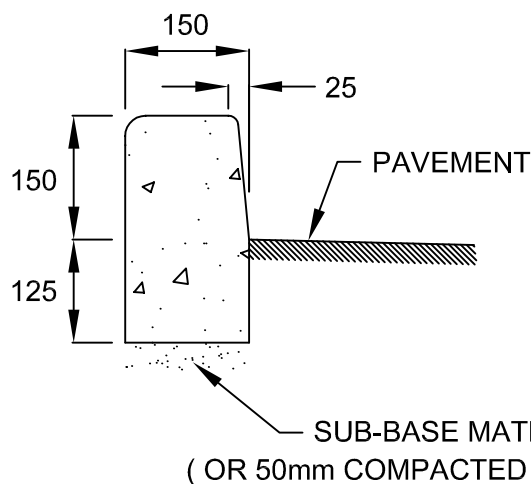

BARRIER KERB ONLY

DRAWN	N. LANGLEY S. HYDE	TOWN OF GAWLER	SCALE N.T.S.
CHECKED	D. COLLINS	STANDARD DETAILS	DRAWING NUMBER
DATE	JUNE 2011	BARRIER KERB AND BARRIER KERB AND GUTTER	SK - 305 REV A