


NOTES

1. PRECAST HEADWALL BY HUMES OR SIMILAR AS ALTERNATIVE FOR SINGLE PIPES UP TO 750mm DIAMETER
2. ALL CONCRETE WORKS TO BE CARRIED OUT IN ACCORDANCE WITH AS 3600, CONCRETE GRADE TO BE N32, MESH TO BE SL82.
3. SAFETY FENCING TO BE PROVIDED ALONG TOP OF HEADWALL AND ALONG WINGWALLS. FENCING TO BE IN ACCORDANCE WITH AS 1926.
4. STREAMLINING TO BE PROVIDED AT UPSTREAM END ONLY
5. STONE PITCH SCOUR PROTECTION TO BE PROVIDED,

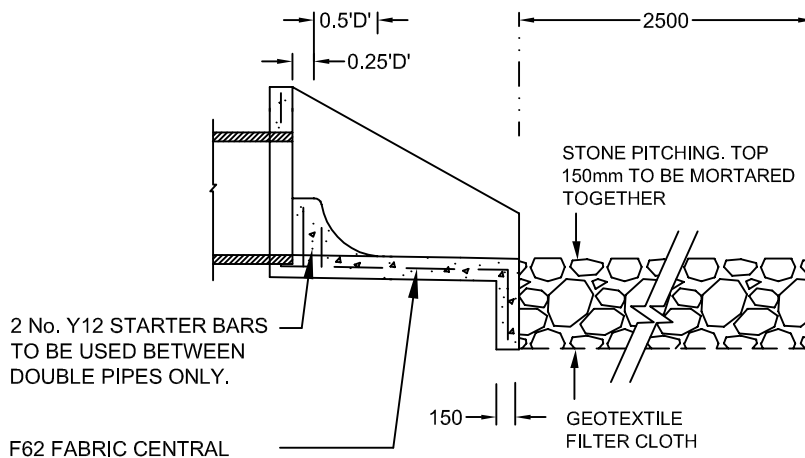

SECTION A-A

DRAWN	N. LANGLEY S. HYDE	TOWN OF GAWLER	SCALE N.T.S.
CHECKED	D. COLLINS	STANDARD DETAILS	DRAWING NUMBER
DATE	JUNE 2011	STANDARD ENDWALLS FOR PIPES 675 - 1800 DIAMETER	SK - 104